

CHINA QUALITY CERTIFICATION CENTRE CO., LTD. CERTIFICATE OF CONFORMITY

Certificate No.: CE230303008318

Product Moulded Case Circuit-Breaker

Applicant ZHEJIANG TENGEN ELECTRIC CO.,LTD.
Sulv Industrial Area, Liushi Town, Yueqing City, Zhejiang
Province, P.R.China

Type/Model TGM1N/TGMH/TGMK/TGMG/TGMD/TGM1BX -400L、
M、H;
TGM1N/TGMH/TGMK/TGMG/TGMD/TGM1BX -630L、
M、H; DZ20C-400, DZ20C-630;

Technical data See the Appendix

This is to certify that, on the basis of the tests undertaken as per Report No. 00901-CE2025CQC0303-016406, the submitted sample(s) of the above item complies with:

EN 60947-2:2017/A1:2020;EN 60947-2:2017

and fulfills testing requirements of the European Directive:

2014/35/EU

This report is to verify the compliance of the sample submitted by the manufacturer only, and does not include the manufacturing process. Users shall affix the mark in accordance with the related legislation.

Valid from: Feb.13,2026

Valid until: Feb.12,2029

The certificate information is available through the QR code below or CNCA's website: www.cnca.gov.cn



SIGNATURE:

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE



CHINA QUALITY CERTIFICATION CENTRE CO., LTD. CERTIFICATE OF CONFORMITY

Appendix

Page 1 of 2

Certificate No.: CE230303008318

TGM1N/TGMH/TGMK/TGMG/TGMD/TGM1BX -400L、M、H;
TGM1N/TGMH/TGMK/TGMG/TGMD/TGM1BX -630L、M、H;
DZ20C-400, DZ20C-630;
Uimp: 12kV;
Ui: 1000V;
Ue: AC380/400/415V, AC660/690V;
In: TGM1N/TGMH/TGMK/TGMG/TGMD/TGM1BX-400L、M、H: 250A、280A、300A、315A、
320A、350A、380A、400A;
TGM1N/TGMH/TGMK/TGMG/TGMD/TGM1BX-630L、M、H: 400A、450A、500A、600A、630A;
DZ20C-400: 250A、280A、300A、315A、320A、350A、380A、400A;
DZ20C-630: 400A、450A、500A、600A、630A;
Over-current release: Thermo-magnetic;
Ics: AC380/400/415V: 35kA (Type L), 50kA (Type M), 75kA (Type H);
AC660/690V: 10kA (Type L, M, H);
DZ20C-400/DZ20C-630: AC380V/400V/415V: 35kA, AC660V/690V: 10kA
Icu: AC380/400/415V: 50kA (Type L), 70kA (Type M), 100kA (Type H);
AC660/690V: 10kA (Type L), 15kA (Type M), 20kA (Type H);
DZ20C-400/DZ20C-630: AC380V/400V/415V: 50kA, 660V/690V: 10kA;
Selectivity category: A;
Trip Class: 10;
3P, 3P+N (3 protected poles with an uninterrupted neutral pole), 4P;
Suitable for isolation (Except 3P+N);
50/60Hz;
Auxiliary contacts (OF-M) and alarm contacts (SD-M):
1NO1NC, 2NO2NC, 4NO4NC;
Ith: 6A;
AC-15: Ue/Ie: AC380/400/415V/1A;



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CE CHINA QUALITY CERTIFICATION CENTRE CO., LTD. CERTIFICATE OF CONFORMITY

Appendix

Page 2 of 2

Certificate No.: CE230303008318


DC-13: Ue/Ie: DC110/220/250V/0.15A;

Accessories with electronic circuits:

Electric operator: AC220/230/240V, AC380/400/415V;

Undervoltage release: AC220/230/240V, AC380/400/415V;

Shunt release: AC220/230/240V, AC380/400/415V;

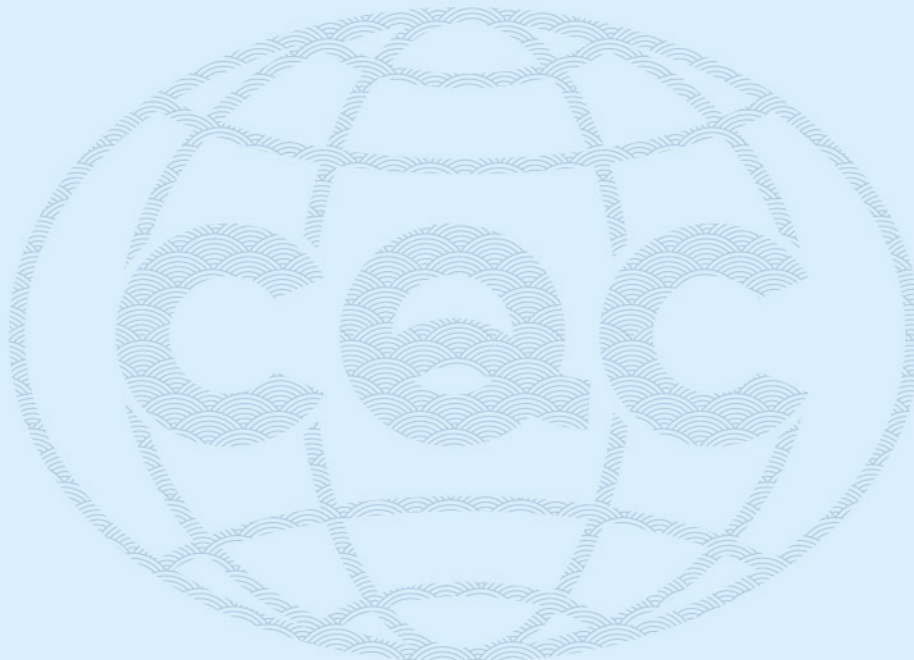

中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE