

CHINA QUALITY CERTIFICATION CENTRE CO., LTD. CERTIFICATE OF CONFORMITY

Certificate No.: CE260305010105

Product AC Contactor

Applicant ZHEJIANG TENGEN ELECTRIC CO.,LTD.
Sulv Industrial Area, Liushi Town, Yueqing City, Zhejiang
Province, P.R.China

Type/Model TGCA-40004,TGCA-50004,TGCA-65004,TGCA-80004,TG
CA-95004

Technical data See the Appendix

This is to certify that, on the basis of the tests undertaken as per Report No.
(2025)MJDQ-CE0578, the submitted sample(s) of the above item complies with:

EN IEC 60947-4-1:2025 to be used in conjunction with EN IEC 60947-1:2021
and fulfills testing requirements of the European Directive:
2014/35/EU

This report is to verify the compliance of the sample submitted by the manufacturer only,
and does not include the manufacturing process. Users shall affix the mark in accordance
with the related legislation.

Valid from: Apr.07,2026

Valid until: Apr.06,2029

The certificate information is available through the QR code below or CNCA's website: www.cnca.gov.cn



SIGNATURE:



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE



CHINA QUALITY CERTIFICATION CENTRE CO., LTD. CERTIFICATE OF CONFORMITY

Appendix

Page 1 of 2

Certificate No.: CE260305010105

TGCA-40004, TGCA-50004, TGCA-65004, TGCA-80004, TGCA-95004

Ui: 1000V; Uimp: 8kV;

Ue: AC220V/240V, AC380V/440V, AC500V/550V, AC660V/690V;

Ith=60A (TGCA-40004), 80A (TGCA-50004), 100A (TGCA-65004), 110A (TGCA-80004), 135A (TGCA-95004);

TGCA-40004:

AC-1: Ue/Ie: AC220V/240V/60A, AC380V/440V/60A, AC500V/550V/60A, AC660V/690V/60A;

AC-3: Ue/Ie: AC220V/240V/40A, AC380V/440V/40A, AC500V/550V/34A, AC660V/690V/34A;

AC-3e: Ue/Ie: AC220V/240V/40A, AC380V/440V/40A, AC500V/550V/34A, AC660V/690V/34A;

AC-4: Ue/Ie: AC220V/240V/18.5A, AC380V/440V/18.5A, AC500V/550V/9A, AC660V/690V/9A;

TGCA-50004:

AC-1: Ue/Ie: AC220V/240V/80A, AC380V/440V/80A, AC500V/550V/80A, AC660V/690V/80A;

AC-3: Ue/Ie: AC220V/240V/50A, AC380V/440V/50A, AC500V/550V/39A, AC660V/690V/39A;

AC-3e: Ue/Ie: AC220V/240V/50A, AC380V/440V/50A, AC500V/550V/39A, AC660V/690V/39A;

AC-4: Ue/Ie: AC220V/240V/24A, AC380V/440V/24A, AC500V/550V/12A, AC660V/690V/12A;

TGCA-65004:

AC-1: Ue/Ie: AC220V/240V/100A, AC380V/440V/100A, AC500V/550V/100A, AC660V/690V/100A;

AC-3: Ue/Ie: AC220V/240V/65A, AC380V/440V/65A, AC500V/550V/42A, AC660V/690V/42A;

AC-3e: Ue/Ie: AC220V/240V/65A, AC380V/440V/65A, AC500V/550V/42A, AC660V/690V/42A;

AC-4: Ue/Ie: AC220V/240V/28A, AC380V/440V/28A, AC500V/550V/14A, AC660V/690V/14A;

TGCA-80004:

AC-1: Ue/Ie: AC220V/240V/110A, AC380V/440V/110A, AC500V/550V/110A, AC660V/690V/110A;

AC-3: Ue/Ie: AC220V/240V/80A, AC380V/440V/80A, AC500V/550V/49A, AC660V/690V/49A;

AC-3e: Ue/Ie: AC220V/240V/80A, AC380V/440V/80A, AC500V/550V/49A, AC660V/690V/49A;

AC-4: Ue/Ie: AC220V/240V/37A, AC380V/440V/37A, AC500V/550V/17.3A, AC660V/690V/17.3A;

TGCA-95004:

AC-1: Ue/Ie: AC220V/240V/135A, AC380V/440V/135A, AC500V/550V/135A, AC660V/690V/135A;

AC-3: Ue/Ie: AC220V/240V/95A, AC380V/440V/95A, AC500V/550V/49A, AC660V/690V/49A;



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE


CE CHINA QUALITY CERTIFICATION CENTRE CO., LTD. CERTIFICATE OF CONFORMITY

Appendix

Page 2 of 2

Certificate No.: CE260305010105

AC-3e: Ue/Ie: AC220V/240V/95A, AC380V/440V/95A, AC500V/550V/49A, AC660V/690V/49A;
AC-4: Ue/Ie: AC220V/240V/44A, AC380V/440V/44A, AC500V/550V/21.3A, AC660V/690V/21.3A;
Us: AC24V, 36V, 48V, 110V, 120V, 220V, 240V, 380V, 400V, 415V, 440V, 50Hz/60Hz;
Degree of protection of enclosure: IP20 (Front side); Number of poles: 4P; 50Hz/60Hz

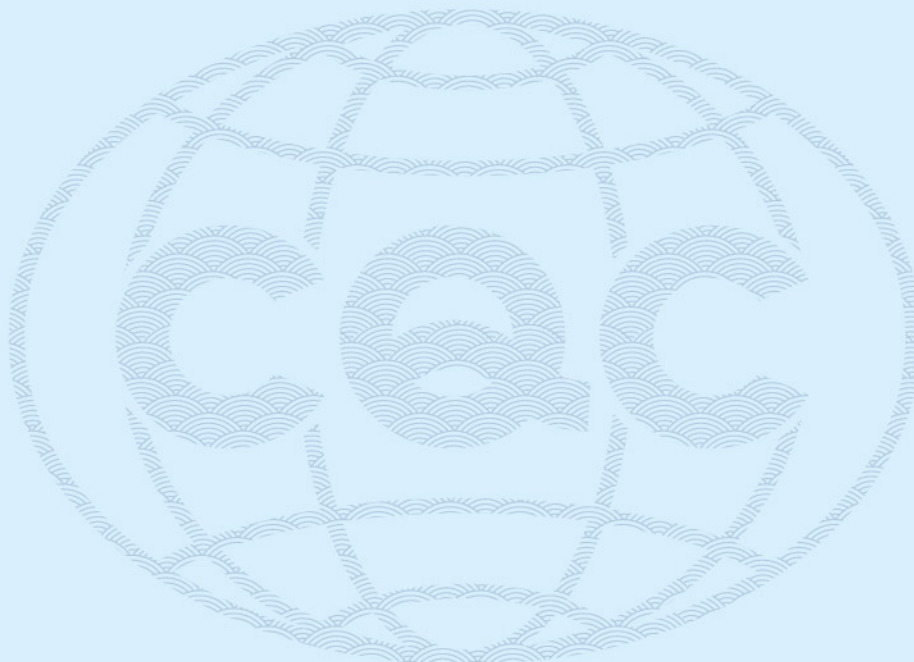

中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE